

Bus coupling unit 3

Art. No. : 2073U

Operating instructions**1 Safety instructions**

Electrical devices may only be mounted and connected by electrically skilled persons.

Serious injuries, fire or property damage possible. Please read and follow manual fully.

During installation and cable routing, comply with the regulations and standards which apply for SELV circuits.

During renovation work, protect the device against soiling through paint, wallpaper paste, dust, etc. Device can be damaged.

These instructions are an integral part of the product, and must remain with the end customer.

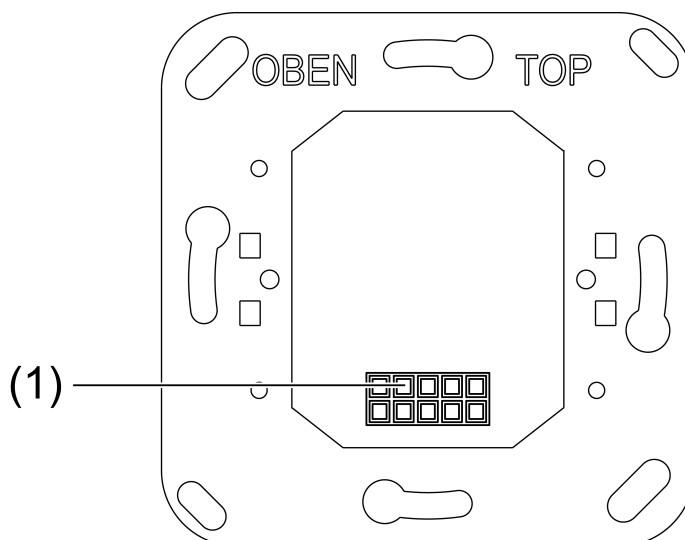
2 Device components

Figure 1: Front side

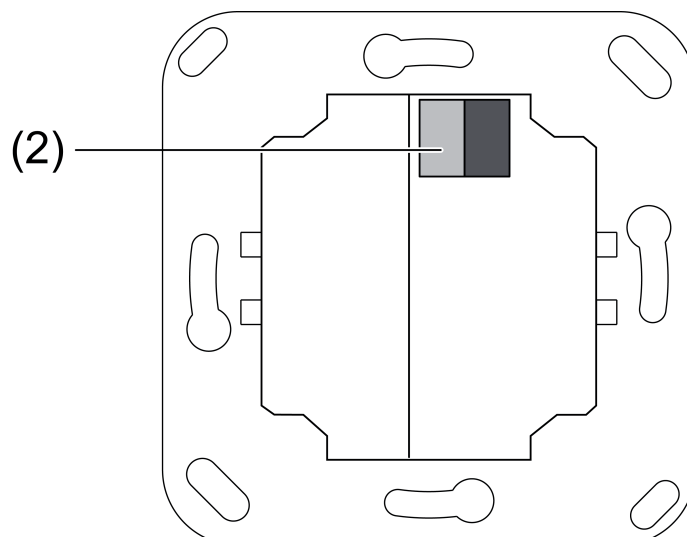


Figure 2: Rear side

- (1) Interface to KNX application module
- (2) Bus connection

3 Function

Intended use

- Coupling of KNX application modules with programming button to KNX systems
 - Installation in appliance box to DIN 49073
- i** The device will not function without an application module.

4 Information for electrically skilled persons

4.1 Fitting and electrical connection



DANGER!

**Electrical shock on contact with live parts in the installation environment.
Electrical shocks can be fatal.**

Before working on the device, disconnect the power supply and cover up live parts in the working environment.

Mounting and connecting the device

Observe the installation orientation. Note marking **TOP**.

- Connect the device to the bus line with the bus connection terminal (2). Red = +, Black = –.
- Install the device in the appliance box.
- Attach the KNX application module.

5 Appendix

5.1 Technical data

Ambient temperature
Storage/transport temperature
Protection class
KNX medium
Rated voltage KNX

-25 ... +55 °C
-25 ... +70 °C
III
TP 256
DC 21 ... 32 V SELV

5.2 Warranty

The warranty follows about the specialty store in between the legal framework as provided for by law.

ALBRECHT JUNG GMBH & CO. KG

Volmestraße 1
58579 Schalksmühle
GERMANY

Telefon: +49 2355 806-0
Telefax: +49 2355 806-204
kundencenter@jung.de
www.jung.de