


HOW COULD I KNOW IF A TOSHIBA SYSTEM CAN BE CONTROLLED WITH ZENNIO GATEWAYS?

1. Identify the model of **indoor units** in the TOSHIBA system.

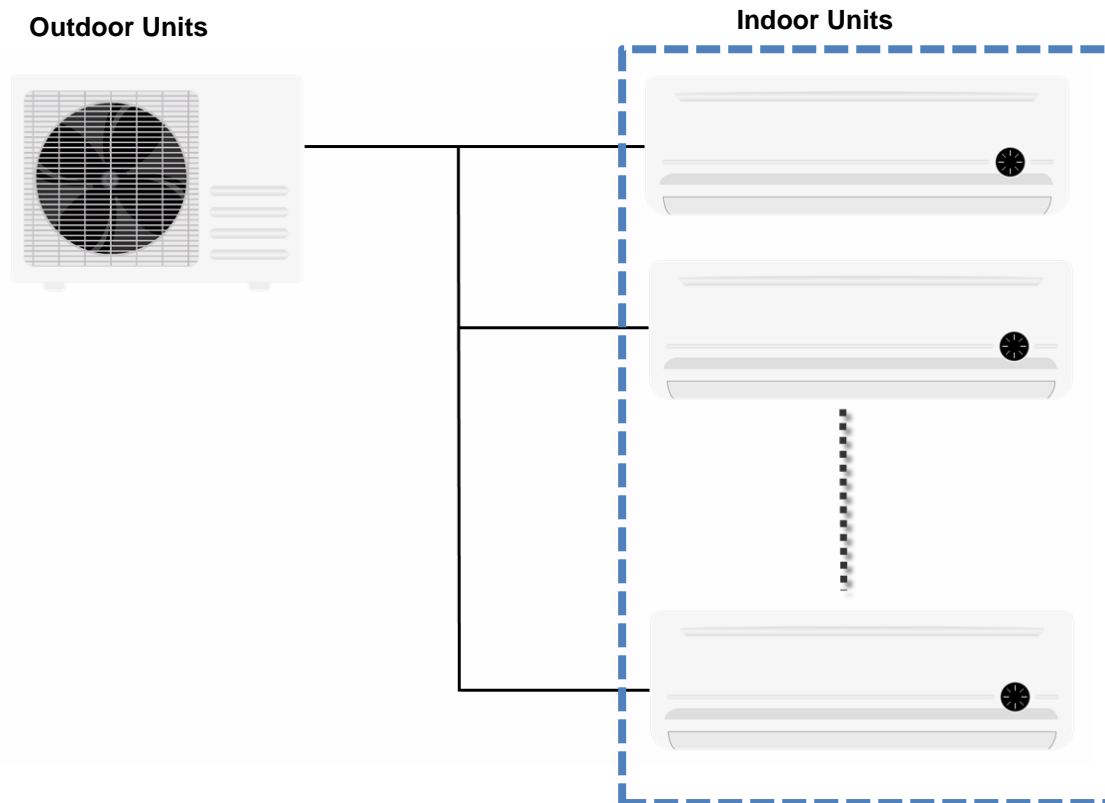

2. You should extract the characters corresponding to the model of indoor unit. Below you can see some examples of indoor units and the characters that correspond to the model:

	Outdoor unit	Indoor unit		Table model
Wall Mounted	RAV-SP564ATP-E	RAV-SM566KRT-E	→	RAV-SM_KRT-E
Ducts	RAV-SP404ATP-E	RAV-SM406BTP-E	→	RAV-SM_BTP-E
Cassette		MMU-AP0562WH1	→	MMU-AP_WH1

3. **Find that model in the compatibility table below** and check if it is compatible with KLIC-TS.
If a model of TOSHIBA indoor unit is not in this list, please, consult with **Zennio Technical Support** <http://support.zennio.com>

COMPATIBILITY OF TOSHIBA INDOOR UNITS WITH KLIC-TS

TYPE	MODEL OF INDOOR UNIT
WALL MOUNTED	RAV-SM_KRT-E
	RAV-SM_KRTP-E
	MMK-AP_H/H1
	MMK-AP_MH-C/MH-E
	MMK-AP_MH1-E/MHP-1
DUCTS	RAV-SM_BT-E/BTP-E/BTP-E1
	RAV-SM_DT-E/DTP-E
	MMD-AP_BH-E/BHP-E/BHP1-E
	MMD-AP_H-E/HP-E/HP-1
SLIM DUCTS	RAV-SM_SDT-E
	MMD-AP_SPH-E/SPH1-E
CEILING	RAV-SM_CT-E/CPT-E
	MMC-AP_H-E/HP-E/HP1-E
CASSTETTE	RAV-SM_MUT-E
	RAV-SM_UT-E/UTP-E
	MMU-AP_MH-E/MH1-E
	MMU-AP_H/HP-E/HP1-E
	MMU-AP_YH-E/YH1-E
	MMU-AP_SH-E/SH1-E
	MMU-AP_WH/WH1
VENTILATION	RAV-DXC010
	MMD-AP_HFE
FLOOR	MML-AP_BH-E/BH1-E
	MML-AP_H-E/H1-E
	MMF-AP_H-E/H1-E
	MML-AP_NH-E/NH1-E

NON-COMPATIBLE UNITS

AIR TO WATER	Estia
---------------------	-------