



# **MAXinBOX Hospitality**

# Two/Four-Pipe Fan Coil Controller with Two Digital Outputs and 6 Analogue/Digital Inputs

ZN1IO-MBH1

Application program version: [2.1] User manual edition: [2.1]\_a

www.zennio.com

# CONTENTS

Con	ten	ts								
Doc	um	ent U	pdates							
1	Int	rodu	ction							
1.	.1	MAX	(inBOX Hospitality							
1.	.2	Insta	illation5							
1.	.3	Start	t-Up and Power Loss6							
1.	.4	Statu	us Indicators6							
	1.4	4.1	Binary and Shutter Outputs7							
	1.4	4.2	Fan Coil Control Outputs (Valve / Fan)7							
2	Со	nfigu	ration8							
2.	.1	Gene	eral8							
2.	.2	Inpu	ts							
	2.2	2.1	Binary Input							
	2.2	2.2	Temperature Probe10							
	2.2	2.3	Motion Detector							
2	.3	Outp	outs							
2	.4	Fan	Coil							
2	.5	Logic Functions								
2	.6	Master Light								
2	.7	Man	ual Control							
ANN	IEX	I. Coi	mmunication Objects							

# **DOCUMENT UPDATES**

Version	Changes	Page(s)
[2.1]_a	<ul> <li>Changes in the application program:</li> <li>Inclusion of the Heartbeat module.</li> <li>Inclusion of the Shutter/Blind control module.</li> <li>Update of the Logic Functions, Master Light Control and Motion Detector modules.</li> </ul>	-
	Inclusion of the Heartbeat module.	4, 9
	Inclusion of the Shutter/Blind control module.	4, 7, 12, 19-21
[2.0]_a	<ul> <li>Changes in the application program:</li> <li>Three-point valve control.</li> <li>New general status object in the Master Light module.</li> <li>Possibility of controlling a third individual output.</li> <li>Optimisation of the manual control function.</li> </ul>	-
[1.1]_a	<ul> <li>Changes in the application program:</li> <li>Optimisation of the timed actions management in the logic functions module.</li> <li>Improvement of the inputs management (certain configurations / combinations were leading to occasional deviations in the readings).</li> <li>Name change of certain fan control or valve control objects.</li> </ul>	-

# **1 INTRODUCTION**

### **1.1 MAXINBOX HOSPITALITY**

MAXinBOX Hospitality from Zennio is a versatile KNX multi-function actuator destined to cover the climate control needs in KNX environments with integrated **fan coil units** where both the fan speed and the opening of the water pipe valves are controlled by relays.

At a glance, the most outstanding features of MAXinBOX Hospitality are:


- 2 multi-purpose relay outputs, configurable as:
  - Up to two binary outputs.
  - > Up to one shutter channel.
- 2 relay outputs to control one three-point valve or up to two on-off valves. One of these outputs can also be configured as an additional multipurpose relay output (in this case, for <u>non-capacitive loads</u>) in case it is not necessary for the fan coil control.
- 3 relay outputs to control up to three fan levels.
- 6 multi-purpose inputs, each of them configurable as:
  - > Temperature probe,
  - Binary input (i.e., pushbuttons, switches, sensors),
  - Motion detector.
- 10 customisable, multi-operation logic functions.
- Master light control for an easy, out-of-the-box control of a set of luminaires (or functionally equivalent devices) one of which acts as a general lamp and the others as secondary lamps.
- Manual operation / supervision of the relay outputs through the on-board pushbuttons and LEDs.
- Heartbeat or periodical "still-alive" notification.

### **1.2 INSTALLATION**

MAXinBOX Hospitality connects to the KNX bus through the on-board KNX connector.

Once the device is provided with power from the KNX bus, both the individual address and the associated application program may be downloaded.

This device does not need any additional external power since it is entirely powered through the KNX bus.

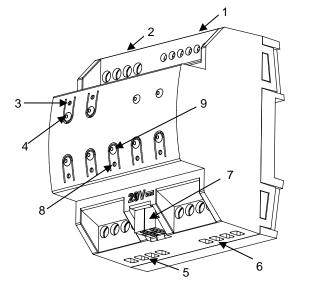

- 1. Multi-purpose Inputs.
- 2. Fan Control Outputs.
- 3. Output Status LED Indicator.
- 4. Manual Control Pushbutton.
- 5. Valve Control Outputs.
- 6. Multi-purpose Binary Outputs.
- 7. KNX Bus Connector.
- 8. Prog./Test LED.
- 9. Prog./Test Pushbutton.

Figure 1 MAXinBOX Hospitality Elements

The main elements of the device are described next.

Prog./Test Pushbutton (9): a short press on this button sets the device into the programming mode, making the associated LED (8) light in red.

<u>Note</u>: if this button is held while plugging the device into the KNX bus, the device will enter into **safe mode**. In such case, the LED will blink in red every 0.5 seconds.

Outputs (2, 5 and 6): output ports for the insertion of the stripped cables of the systems being controlled by the actuator (see sections 2.3 and 2.4). Please secure the connection by means of the on-board screws. Inputs (1): input ports for the insertion of the stripped cables of external elements such as switches / motion detectors / temperature probes, etc. One of the two cables of each element needs to be connected to one of the slots labelled "1" to "6", while the other cable should be connected to the slot labelled as "C". Note that all the external input devices share the "C" slot for one of the two cables. Please secure the connection by means of the on-board screws.

For detailed information about the technical features of the device and for safety instructions or about the installation process, please refer to the corresponding **Datasheet**, bundled with the original package of the device and also available at <u>www.zennio.com</u>.

### **1.3 START-UP AND POWER LOSS**

During the device start-up, the Prog./Test LED will blink **in blue colour** for a few seconds before MAXinBOX Hospitality is ready. External orders will not be executed during this time, but afterwards.

Depending on the configuration, **some specific actions** will also be performed during the start-up. For example, the integrator can set whether the output channels should switch to a particular state and whether the device should send certain objects to the bus after the power recovery. Please consult the next sections of this document for further details.

On the other hand, when **a bus power failure** takes place, MAXinBOX Hospitality will interrupt any pending actions, and will save its state so it can be recovered once the power supply is restored. In addition, the individual outputs will switch to the specific state configured in parameters.

# **1.4 STATUS INDICATORS**

Each of the outputs of MAXinBOX Hospitality incorporates a light indicator that reflects its current state.

#### 1.4.1 BINARY AND SHUTTER OUTPUTS

If an output is configured as binary, the LED indicator will only be on while the relay remains closed; otherwise it remain off.

If configured as a shutter channel, the LED indicator will only remain on while the shutter is in motion.

Please refer to section 2.3 for details about the relay outputs.

#### 1.4.2 FAN COIL CONTROL OUTPUTS (VALVE / FAN)

Regarding the **valve control outputs**, the LED indicator of each output will behave analogously as the LEDs of the binary outputs: it will remain off while the corresponding valve is closed (open relay) and on while the corresponding valve is open (closed relay),

Regarding the **fan control outputs**, the two LED indicators provide information about the current fan speed level:

- Fan switched off: both LEDs off.
- Fan at speed level 1: both LEDs blinking every 1 second.
- Fan at speed level 2: both LEDs blinking every 0.5 seconds.
- Fan at speed level 3: both LEDs steadily on.

In case **less than three different speed levels** have been parameterised, the LEDs will stay steadily on while the fan is at the maximum level (e.g., level 2), and as described above for the lower levels (e.g., levels 1 and off).

Please refer to section 2.4 for details about the fan coil control outputs.

# 2 CONFIGURATION

### 2.1 GENERAL

After importing the corresponding database in ETS and adding the device into the topology of the desired project, the configuration process begins by right-clicking into the device and selecting *Edit Parameters*.

#### **ETS PARAMETERISATION**

From the "General" screen it is possible to mark/unmark the appropriate checkboxes to enable the required functionality. The only one active by default is "**Manual Control**" (see section 2.7), thus the corresponding tab will also be available from the beginning in the tab tree on the left.

	GENERAL	Inputs	
Þ	Manual Control	Fan Coil	
		Outputs	
		Logic Functions	
		Master Light	
		Manual Control	<b>√</b>
		Sending of Indication Objects (0 and 1) on Bus Voltage Recovery	
		Heartbeat (Periodical Alive Notification)	



- Once activated, Inputs, Binary Outputs, Fan Coil, Logical Functions, Manual Control (enabled by default) and Master Light bring additional tabs to the menu on the left. These functions and their parameters will be explained in later sections of this document.
- Sending of Indication Objects (0 and 1) on Bus Voltage Recovery: this parameter lets the integrator activate two new communication objects ("Reset 0" and "Reset 1"), which will be sent to the KNX bus with values "0" and "1" respectively whenever the device begins operation (for example, after a bus

power failure). It is possible to parameterise a certain **delay** to this sending (0 to 255 seconds).

Heartbeat (Periodical Alive Notification): lets the integrator incorporate a one-bit object to the project ("[Heartbeat] Object to Send '1'") that will be sent periodically with value "1" to notify that the device is still working (*still alive*).

# 2.2 INPUTS

MAXinBOX Hospitality incorporates 6 analogue/digital inputs, each configurable as a:

- **Binary Input**, for the connection of a pushbutton or a switch/sensor.
- Temperature Probe, to connect a temperature sensor (models SQ-AmbienT and ZN1AC-NTC68 S/E/F from Zennio).
- Motion Detector, to connect a motion detector (models ZN1IO-DETEC-P and ZN1IO-DETEC-X from Zennio).

#### Notes:

Older models of the Zennio motion detector (e.g., ZN1IO-DETEC and ZN1IO-DETEC-N) will not work properly with MAXinBOX Hospitality.

#### 2.2.1 BINARY INPUT

Please refer to the "**Binary Inputs**" user manual, available under the MAXinBOX Hospitality product section at <u>www.zennio.com</u>.

#### 2.2.2 TEMPERATURE PROBE

Please refer to the "**Temperature Probe**" user manual, available under the MAXinBOX Hospitality product section at <u>www.zennio.com</u>.

#### 2.2.3 MOTION DETECTOR

It is possible to connect motion detectors (models **ZN1IO-DETEC-P** and **ZN1IO-DETEC-X** from Zennio) to the input ports of MAXinBOX Hospitality. This brings the device with the possibility of monitoring motion and presence in the room, as well as the light level. Depending on the detection, different response actions can be parameterised.

Please refer to the "**Motion Detector**" user manual, available under the MAXinBOX Hospitality product section at <u>www.zennio.com</u>, for detailed information about the functionality and the configuration of the related parameters.

#### Notes:

- The ZN1IO-DETEC-P motion detector is compatible with a variety of Zennio devices. However, depending on the device it is actually being connected to, the functionality may differ slightly. Therefore, please refer specifically to the aforementioned user manual.
- Motion detectors with references ZN1IO-DETEC and ZN1IO-DETEC-N are not compatible with MAXinBOX Hospitality (may report inaccurate measurements if connected to this device).
- When connected to MAXinBOX Hospitality, the rear micro-switch of model ZN1IO-DETEC-P should be set to position "Type B".

# 2.3 OUTPUTS

MAXinBOX Hospitality incorporates two relay outputs, which can be configured in parameters as individual **binary outputs** to control up to two different loads, or as a joint **shutter channel** to control shutters and blinds, with or without slats.

Moreover, in case the fan coil module remains disabled (see section 2.4) or is configured to control a two-pipe fan coil unit consisting of a sole on-off valve, it is possible to configure one of the two valve control relay outputs (V2) as **a third multi-purpose binary output**, although not valid to control <u>capacitive loads</u>.

#### PARAMETERISATION

When the Outputs function has been activated in the "General" parameter screen, the "**Outputs**" section will be available in the tree on the left, containing itself a tab named "**Configuration**".

4	GENERAL OUTPUTS	Channel A	Disabled 🔹
	CONFIGURATION	Binary Output 3 (V2)	
Þ	Manual Control	Note: Binary Output 3 Must Not Be Used v	vith Capacitive Loads.

Figure 3 Outputs - Configuration

Channel A can be configured through the drop-down list as two independent **binary outputs** or as a **shutter channel** (which makes use of both relays). **Binary output V2** will also be available for configuration once the Fancoil function has been disabled.

According to the above configuration, new entries will be incorporated into the tab tree.

For detailed information about the functionality and the configuration of the related parameters, please refer to the following specific manuals, available in the MAXinBOX Hospitality product section at the Zennio homepage (<u>www.zennio.com</u>):

- Individual outputs.
- Shutter channels.

# 2.4 FAN COIL

MAXinBOX Hospitality incorporates one **fan coil control module**, which will be responsible for operating the relays than open and close the water pipe valves (either one three-point valve or up to two on-off valves), and the relays that set the fan speed level. The latter can be achieved through **relay accumulation** (more relays closed means a higher fan speed) or through **relay commutation** (one specific relay will be available per level), depending on the configuration.

For a detailed description of these functions and on their configuration, please refer to the specific manual "**Relays Fan Coil**", available under the MAXinBOX Hospitality product section at <u>www.zennio.com</u>.

# 2.5 LOGIC FUNCTIONS

This module makes it possible to perform numeric and binary operations to incoming values received from the KNX bus, and to send the results through other communication objects specifically enabled for this purpose.

MAXinBOX Hospitality allows enabling and fully customising up to **ten different logic functions** with their corresponding input objects, whose size can be 1 bit, 1 byte, 2 bytes or 4 bytes.

The execution of each function can depend on a configurable **condition**, which will be evaluated every time the function is **triggered** through specific, parameterisable communication objects. The result after executing the operations of the function can also be evaluated according to certain **conditions** and afterwards sent (or not) to the KNX bus, which can be done every time the function is executed, periodically or only when the result differs from the last one.

For detailed information about the functionality and the configuration of the related parameters, please refer to the specific manual "**Logic Functions**" available under the MAXinBOX Hospitality product section at the <u>www.zennio.com</u> website.

### 2.6 MASTER LIGHT

The Master Light function brings the option to monitor the state of up to 12 light sources (or even more, if the Master Light controls from multiple Zennio devices are linked together) or of any other elements whose state is transmitted through a binary object and, depending on those states, perform a *master order* every time a certain trigger signal (again, a binary value) is received through a specific object.

Such master order will consist in:

- A general switch-off order, if at least one of the up to twelve status objects is found to be on.
- A courtesy switch-on order, if none of the up to twelve status objects is found to be on.

Note that the above switch-off and switch-on orders are not necessarily a binary value being sent to the bus – it is up to the integrator the decision of what to send to the KNX bus in both cases: a shutter order, a thermostat setpoint or mode switch order, a constant value, a scene... Only the trigger object and the twelve status objects are required to be binary (on/off).

The most typical scenario for this Master Light control would be a hotel room with a master pushbutton next to the door. When leaving the room, the guest will have the possibility of pressing on the master pushbutton and make all the lamps turn off together. Afterwards, back on the room and with all the lamps off, pressing on the same master pushbutton will only make a particular lamp turn on (e.g., the closest lamp to the door) – this is the courtesy switch-on.

Besides, it is possible to concatenate two or more Master Light modules by means of a specific communication object which represents the general state of the light sources of each module. Thereby, it is possible to expand the number of light sources by considering the general state of one module as an additional light source for another.

#### ETS PARAMETERISATION

Once the Master Light function has been enabled, a specific tab will be included in the menu on the left. This new parameter screen () contains the following options:

• Number of State Objects: defines the number of 1-bit status objects required. The minimum (and default) value is "<u>1</u>", and the maximum is "<u>12</u>". These objects are called "[ML] Status Object n".

In addition, the general status object ("**[ML] General status**") will always be available in the project topology. It will be sent to the bus with a value of "1" whenever there is at least one of the above state objects with such value. Otherwise (i.e., if none of them has a value of "1"), it will be sent with a value of "0".

• Trigger Value: sets the value ("<u>0</u>", "<u>1</u>" or "<u>0/1</u>", being the latter the default option) that will trigger, when received through "[ML] Trigger", the master action (the general switch-off or the courtesy switch-on).

#### General Switch-Off.

- Delay: defines a certain delay (once the trigger has been received) before the execution of the general switch-off. The allowed range is 0 to 255 seconds.
- Binary Value: if checked, object "[ML] General Switch-off: Binary Object" will be enabled, which will send one "0" whenever the general switch-off takes off.
- Scaling: if checked, object "[ML] General Switch-off: Scaling" will be enabled, which will send a percentage value (configurable in "Value") whenever the general switch-off takes off.
- Scene: if checked, object "[ML] General Switch-off: Scene" will be enabled, which will send a scene run / save order (configurable in "Action" and "Scene Number") whenever the general switch-off takes off
- HVAC: if checked, object "[ML] General Switch-off: HVAC mode" will be enabled, which will send an HVAC thermostat mode value (configurable in "Value", being the options "<u>Auto</u>", "<u>Comfort</u>", "<u>Standby</u>", "<u>Economy</u>" and "<u>Building Protection</u>") whenever the general switch-off takes off

<u>Note</u>: the above options are not mutually exclusive; it is possible to send values of different nature together.

#### • Courtesy Switch-On:

The parameters available here are entirely analogous to those already mentioned for General Switch-Off. However, in this case the names of the objects start with "[ML] Courtesy Switch-On (...)". On the other hand, sending scene save orders is not possible for the courtesy switch-on (only orders to play scenes are allowed).

<u>Note</u>: object "[ML] Courtesy Switch-On: Binary Object" sends the value "1" (when the courtesy switch-on takes place), in contrast to object "[ML] General Switch-Off: Binary Object", which sends the value "0" (during the general switch-off, as explained above).

GENERAL	Number of State Objects	1
MASTER LIGHT     CONFIGURATION		
	Trigger Value	0/1
	General Switch-Off	
	Delay	0 🛋 x 1 s.
	Binary Value	✓
	Scaling	
	Scene	
	HVAC	
	Courtesy Switch-On	
	Delay	0 👘 x 1 s.
	Binary Value	✓
	Scaling	
	Scene	
	HVAC	

#### Figure 4 Master Light

# 2.7 MANUAL CONTROL

MAXinBOX Hospitality allows manually switching the state of its output relays through the respective pushbuttons on the top of the device. A specific pushbutton is therefore available per output.

Manual operation can be done in two different ways, named as **Test On Mode** (for testing purposes during the configuration of the device) and **Test Off Mode** (for a normal use, anytime). Whether both, only one, or none of these modes should be accessible needs to be parameterised in ETS. Moreover, it is possible to enable a specific binary object **for locking and unlocking the manual control** in runtime.

#### Notes:

- The available control modes (Test On / Test Off) and the lock object can be enabled and disabled in MAXinBOX Hospitality independently for the relay outputs (binary or shutter) and for the fan coil outputs (valves and fan).
- The Test Off mode will be active (unless it has been disabled by parameter) after a download or a reset with no need of a specific activation – the pushbuttons will respond to user presses from the start.
- On the contrary, switching to the **Test On mode** (unless disabled by parameter) needs to be done by long-pressing the Prog./Test button (for at least three seconds), until the LED is no longer red and turns yellow. From that moment, once the button is released, the LED light will remain green to confirm that the device has switched from the Test Off mode to the Test On mode. After that, an additional press will turn the LED yellow and then off, once the button is released. This way, the device leaves the Test On mode. Note that it will also leave this mode if a bus power failure takes place.

This device is delivered from factory with the Test On and Test Off modes **already** enabled in parameters for all outputs.

### **Test Off Mode**

Under the Test Off Mode, the outputs can be controlled through both their communication objects and the actual pushbuttons located on the top of the device.

When one of these buttons is pressed, the output will behave as if an order had been received through the corresponding communication object, so it has no effect if the output is locked or under alarm status. The status objects of the different functions will still be sent in the usual way.

The action performed depends on the output type.

- Individual output: a simple press (short or long) will make the output (if enabled in parameters) switch its on-off state. This will be reported to the KNX bus through the corresponding status object, if enabled.
- Shutter channel: when the button is pressed, the device will act over the output according to the length of the button press and to the current state.
  - A long press makes the shutter start moving (upwards or downwards, depending on the button being pressed). The LED will light in green until the end of the motion. If the button gets pressed being the shutter already at the top or bottom positions, nothing will happen (the LED will not light).
  - A short press will make the shutter drive stop (if in motion), as it normally does when a step/stop order is received from the KNX bus. In case of not being the shutter in motion, pressing the button does not cause any action, unless slats/lamellas have been parameterized – in such case, a step movement (up/down, depending on the button pressed) will take place. The status objects will be sent to the bus when corresponding
- Fan: a simple press (short or long) implies an increase or decrease of the fan speed (provided that the fan coil has been enabled in parameters), depending on the button pressed. This action will depend on the fan type (relay accumulation / relay commutation), the control type (cyclical or non-cyclical) and the minimum switch time configured. In particular:

- If the fan is already at the maximum speed level, a further increase will have no effect (in case of a non-cyclical control) or will switch back to the minimum level (in case of a cyclical control).
- If the fan is already at the minimum speed level, a further decrease will have no effect (in case of a non-cyclical control) or will switch back to the maximum level (in case of a cyclical control).
- Valve: a simple press (short or long) will make the valve switch its open/closed state, provided that the fan coil has been enabled in parameters. In case the fan coil control type has been configured in parameters as "applied to the fan" (instead of "applied to the valve"), this may also imply:
  - A switch-on of the fan, if it is found to be stopped and the valve opens, provided that the desired fan speed is other than zero.
  - A switch-off of the fan, it is found to be in motion and the valve closes, provided that the current mode is Heating (under Cooling, the fan will remain as is).
- Disabled output: outputs disabled in parameters will not react to button presses under the Test Off mode.

Regarding the lock, timer, alarm and scene functions, the device will behave as usual under the Test Off mode. Button presses during this mode are entirely analogous to the reception of the corresponding orders from the KNX bus.

#### **Test On Mode**

After entering the Test On mode, it will only be possible to control the outputs through the on-board pushbuttons. Orders received through communication objects will be ignored, with independence of the output they are addressed to.

On the other hand, to prevent interference with the normal operation and since the Test On mode is intended for testing, once the device leaves the Test On mode it will **switch back to its previous state**.

Depending on the parameterisation of the output, the reactions to the button presses will differ.

- Individual outputs: short or long pressing the button will commute the on-off state of the relay.
- Shutter channel: pressing the button will make the shutter drive move upward or downward (depending on the button) until the button is released again, thus ignoring the position of the shutter and the parameterised times.

**Note**: after leaving the Test On mode, the status objects will recover the values they had prior to entering Test On. As the device is never aware of the actual position of the shutter (as the shutter drive does not provide any feedback), these values may not show the real position. This can be solved by performing a complete move-up or move-down order, or by calibrating the shutter position in the Test On mode until it matches the status objects.

- Fan: a simple press (short or long) implies an increase or decrease of the fan speed, depending on the button pressed.
  - In case the fan coil module is disabled in parameters, it will work as non-cyclical and through relay switching (with a 0.3 s delay).
  - In any other case, the Test On mode will still respect the cyclical / noncyclical configuration, and the relay management type parameterised.
- Valves: a simple press (short or long) will make the valve switch its open/closed state. The behaviour is analogous as for the Test Off mode, although both valves will be controllable in Test On even if not enabled in parameters.
- Disabled outputs: under the Test On mode, short and long presses will cause the same effect for disabled outputs as for individual outputs (i.e., the relay will switch its state).

The lock, timer, alarm and scene functions will not work while the device is under the Test On mode. Status objects will not be sent to the bus, either. However, alarms and lock orders received during the Test On mode will be taken into account once the device leaves this mode.

#### **ETS PARAMETERISATION**

The **Manual Control** is configured from a specific tab which can be enabled from the "General" screen (see section 2.1).

GENERAL FAN COIL CONFIGURATION MANUAL CONTROL CONFIGURATION	BINARY OUTPUTS MANUAL CONTROL Mode Test Mode Off + Test Mode On Lock Manual Control?			
	FAN COIL MANUAL CONTROL Mode Lock Manual Control?	Test Mode Off + Test Mode On		



The parameters available in this screen are grouped into two sections, as it is possible to **configure independently the behaviour of the Manual Control for both**, the *fan coil* and the individual binary outputs:

Mode: options are "<u>Disabled</u>", "<u>Only Test Mode Off</u>", "<u>Only Test Mode On</u>" and "<u>Test Mode Off + Test Mode On</u>" (default).

Depending on the selection, the device will permit using the manual control under the Test Off, the Test On, or both modes. Note that, as stated before, using the Test Off mode does not require any special action, while switching to the Test On mode does require long-pressing the Prog./Test button.

- Lock Manual Control: unless the above parameter has been set to "<u>Disabled</u>", enabling the Lock Manual Control parameter will provide a runtime procedure for locking the manual control. When this checkbox is enabled, object "Manual Control Lock" turns visible, as well as two more parameters:
  - Value: defines whether the lock/unlock of the manual control should take place respectively upon the reception (through the aforementioned object) of values "0" and "1", or the opposite.

Initialisation: sets how the manual control should remain after the device start-up (after an ETS download or a bus power failure): "Unlocked", "Locked" or by default, "Last Value" (unlocked after the first start-up).

# ANNEX I. COMMUNICATION OBJECTS

• "Functional range" shows the values that, with independence of any other values permitted by the bus according to the object size, may be of any use or have a particular meaning because of the specifications or restrictions from both the KNX standard or the application program itself.

Number	Size	1/0	Flags	Data type (DPT)	Functional Range	Name	Function
1	1 Bit		СТ	DPT_Trigger	0/1	Reset 0	Voltage Recovery -> Sending of 0
2	1 Bit		СТ	DPT_Trigger	0/1	Reset 1	Voltage Recovery -> Sending of 1
3	1 Bit	Ι	C W -	DPT_Enable	0/1	Lock Manual Control (Binary Outputs)	0 = Lock; 1 = Unlock
3	1 Bit	Ι	C W -	DPT_Enable	0/1	Lock Manual Control (Binary Outputs)	0 = Unlock; 1 = Lock
	1 Bit	Ι	C W -	DPT_Enable	0/1	Lock Manual Control (Fan Coil)	0 = Unlock; 1 = Lock
4	1 Bit	Ι	C W -	DPT_Enable	0/1	Lock Manual Control (Fan Coil)	0 = Lock; 1 = Unlock
5, 9, 13, 17, 21, 25	2 Bytes	0	C T R	DPT_Value_Temp	-273.00 - 670760.00	[Ix] Current Temperature	Temperature sensor value
6. 10, 14, 18, 22, 26	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] Overcooling	0 = No Alarm; 1 = Alarm
7, 11, 15, 19, 23, 27	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] Overheating	0 = No Alarm; 1 = Alarm
8, 12, 16, 20, 24, 28	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] Probe Error	0 = No Alarm; 1 = Alarm
29, 35, 41, 47, 53, 59	1 Bit	Ι	C W -	DPT_Switch	0/1	[Ix] Input Lock	1 = Locked; 0 = Unlocked
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Short Press] 0	Sending of 0
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Short Press] 1	Sending of 1
	1 Bit	Ι	C T - W -	DPT_Switch	0/1	[Ix] [Short Press] 0/1 Switching	Switching 0/1
	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Short Press] Move Up Shutter	Sending of 0 (Up)
	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Short Press] Move Down Shutter	Sending of 1 (Down)
30, 36, 42, 48, 54, 60	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Short Press] Move Up/Down Shutter	Switching 0/1 (Up/Down)
	1 Bit		СТ	DPT_Step	0/1	[Ix] [Short Press] Stop/Step Up Shutter	Sending of 0 (Stop/Step Up)
	1 Bit		СТ	DPT_Step	0/1	[Ix] [Short Press] Stop/Step Down Shutter	Sending of 1 (Stop/Step Down)
	1 Bit		СТ	DPT_Step	0/1	<pre>[Ix] [Short Press] Stop/Step Shutter (Switched)</pre>	Switching of 0/1 (Stop/Step Up/Down)
	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop)	[Ix] [Short Press] Brighter	Increase Brightness

					0x1 (Dec. by 100%) 0x2 (Dec. by 50%) 0x3 (Dec. by 25%) 0x4 (Dec. by 12%) 0x5 (Dec. by 12%) 0x6 (Dec. by 3%) 0x7 (Dec. by 1%) 0x8 (Stop) 0x8 (Stop) 0x9 (Inc. by 100%) 0x8 (Inc. by 50%) 0x8 (Inc. by 25%) 0xC (Inc. by 12%) 0xE (Inc. by 3%) 0xF (Inc. by 1%)		
	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop) 0x1 (Dec. by 100%)  0x8 (Stop) 0x9 (Inc. by 100%)  0xF (Inc. by 1%)	[Ix] [Short Press] Darker	Decrease Brightness
	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop) 0x1 (Dec. by 100%)  0x8 (Stop)  0xF (Inc. by 1%)	[Ix] [Short Press] Brighter/Darker	Switch Bright/Dark
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Short Press] Dimmer ON	Sending of 1 (ON)
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Short Press] Dimmer OFF	Sending of 0 (OFF)
	1 Bit	Ι	C T - W -	DPT_Switch	0/1	[Ix] [Short Press] Dimmer ON/OFF	Switching 0/1
	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[Ix] [Short Press] Run Scene	Sending of 0 - 63
	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[Ix] [Short Press] Save Scene	Sending of 128 - 191
	1 Bit	1/0	CTRW-	DPT_Switch	0/1	[Ix] [Switch/Sensor] Edge	Sending of 0 or 1
	1 Byte		СТ	DPT_Value_1_Ucount	0 - 255	[Ix] [Short Press] Constant Value (Integer)	0 - 255
	1 Byte		СТ	DPT_Scaling	0% - 100%	[Ix] [Short Press] Constant Value (Percentage)	0% - 100%
	2 Bytes		СТ	DPT_Value_2_Ucount	0 - 65535	[Ix] [Short Press] Constant Value (Integer)	0 - 65535
	2 Bytes		СТ	9.xxx	-671088.64 - 670760.96	[Ix] [Short Press] Constant Value (Float)	Float value
31, 37, 43, 49, 55, 61	1 Byte	Ι	C W -	DPT_Scaling	0% - 100%	[Ix] [Short Press] Shutter Status	0% = Top; 100% = Bottom

						(Input)	
	1 Byte	I	C W -	DPT_Scaling	0% - 100%	[Ix] [Short Press] Dimming Status (Input)	0% - 100%
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Long Press] 0	Sending of 0
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Long Press] 1	Sending of 1
	1 Bit	-	C T - W -	DPT_Switch	0/1	[Ix] [Long Press] 0/1 Switching	Switching 0/1
	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Long Press] Move Up Shutter	Sending of 0 (Up)
	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Long Press] Move Down Shutter	Sending of 1 (Down)
	1 Bit		СТ	DPT_UpDown	0/1	[Ix] [Long Press] Move Up/Down Shutter	Switching 0/1 (Up/Down)
	1 Bit		СТ	DPT_Step	0/1	[Ix] [Long Press] Stop/Step Up Shutter	Sending of 0 (Stop/Step Up)
	1 Bit		СТ	DPT_Step	0/1	[Ix] [Long Press] Stop/Step Down Shutter	Sending of 1 (Stop/Step Down)
	1 Bit		СТ	DPT_Step	0/1	[Ix] [Long Press] Stop/Step Shutter (Switched)	Switching of 0/1 (Stop/Step Up/Down)
32, 38, 44, 50, 56, 62	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop) 0x1 (Dec. by 100%)  0x8 (Stop) 0x9 (Inc. by 100%)  0xF (Inc. by 1%)	[Ix] [Long Press] Brighter	Long Pr> Brighter; Release -> Stop
	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop) 0x1 (Dec. by 100%)  0x8 (Stop) 0x9 (Inc. by 100%)  0xF (Inc. by 1%)	[Ix] [Long Press] Darker	Long Pr> Darker; Release -> Stop
	4 Bit		СТ	DPT_Control_Dimming	0x0 (Stop) 0x1 (Dec. by 100%)  0x8 (Stop) 0x9 (Inc. by 100%)  0xF (Inc. by 1%)	[Ix] [Long Press] Brighter/Darker	Long Pr> Brighter/Darker; Release - > Stop
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Long Press] Dimmer ON	Sending of 1 (ON)
	1 Bit		СТ	DPT_Switch	0/1	[Ix] [Long Press] Dimmer OFF	Sending of 0 (OFF)
	1 Bit	Ι	C T - W -	DPT_Switch	0/1	[Ix] [Long Press] Dimmer ON/OFF	Switching 0/1
	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[Ix] [Long Press] Run Scene	Sending of 0 - 63

	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[Ix] [Long Press] Save Scene	Sending of 128 - 191
	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] [Switch/Sensor] Alarm: Breakdown or sabotage	1 = Alarm; 0 = No Alarm
	2 Bytes		СТ	9.xxx	-671088.64 - 670760.96	[Ix] [Long Press] Constant Value (Float)	Float value
	2 Bytes		СТ	DPT_Value_2_Ucount	0 - 65535	[Ix] [Long Press] Constant Value (Integer)	0 - 65535
	1 Byte		СТ	DPT_Scaling	0% - 100%	[Ix] [Long Press] Constant Value (Percentage)	0% - 100%
	1 Byte		СТ	DPT_Value_1_Ucount	0 - 255	[Ix] [Long Press] Constant Value (Integer)	0 - 255
33, 39, 45, 51, 57, 63	1 Bit		СТ	DPT_Trigger	0/1	[Ix] [Long Press/Release] Stop Shutter	Release -> Stop Shutter
34, 40, 46, 52, 58, 64	1 Byte	I	C W -	DPT_Scaling	0% - 100%	[Ix] [Long Press] Dimming Status (Input)	0% - 100%
34, 40, 46, 52, 56, 64	1 Byte	Ι	C W -	DPT_Scaling	0% - 100%	[Ix] [Long Press] Shutter Status (Input)	0% = Top; 100% = Bottom
65	1 Byte	Ι	C W -	DPT_SceneControl	0-63; 128-191	[Motion Detector] Scene Input	Scene Value
66	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[Motion Detector] Scene Output	Scene Value
67, 96, 125, 154 183, 212	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[Ix] Luminosity	0-100%
68, 97, 126, 155, 184, 213	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] Open Circuit Error	0 = No Error; 1 = Open Circuit Error
69, 98, 127, 156, 185, 214	1 Bit	0	C T R	DPT_Alarm	0/1	[Ix] Short Circuit Error	0 = No Error; 1 = Short Circuit Error
70, 99, 128, 157, 186, 215	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[Ix] Presence State (Scaling)	0-100%
71, 100, 129, 158, 187, 216	1 Byte	0	C T R	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[Ix] Presence State (HVAC)	Auto, Comfort, Standby, Economy, Building Protection
72, 101, 130, 159, 188, 217	1 Bit	0	C T R	DPT_Occupancy	0/1	[Ix] Presence State (Binary)	Binary Value
72, 101, 130, 139, 188, 217	1 Bit	0	C T R	DPT_Trigger	0/1	[Ix] Presence: Slave Output	1 = Motion Detected
73, 102, 131, 160, 189, 218	1 Bit	Ι	C W -	DPT_Window_Door	0/1	[Ix] Presence Trigger	Binary Value to Trigger the Presence Detection
74, 103, 132, 161, 190, 219	1 Bit	I	C W -	DPT_Trigger	0/1	[Ix] Presence: Slave Input	0 = Nothing; 1 = Detection from slave device
75, 104, 133, 162, 191, 220	2 Bytes	I	C W -	DPT_TimePeriodSec	0 - 65535	[Ix] Presence: Waiting Time	0-65535 s.
76, 105, 134, 163, 192, 221	2 Bytes	Ι	C W -	DPT_TimePeriodSec	0 - 65535	[Ix] Presence: Listening Time	1-65535 s.
77, 106, 135, 164, 193, 222	1 Bit	Ι	C W -	DPT_Switch	0/1	[Ix] Presence: Enable	According to parameters
78, 107, 136, 165, 194, 223	1 Bit	Ι	C W -	DPT_Switch	0/1	[Ix] Presence: Day/Night	According to parameters
79, 108, 137, 166, 195, 224	1 Bit	0	C T R	DPT_Occupancy	0/1	[Ix] Presence: Occupancy State	0 = Not Occupied; 1 = Occupied
80, 109, 138, 167, 196, 225	1 Bit	I	C W -	DPT_Trigger	0/1	[Ix] External Motion Detection	0 = Nothing; 1 = Motion detected by an external sensor

81, 86, 91, 110, 115, 120, 139, 144, 149, 168, 173, 178, 197, 202, 207, 226, 231, 236	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[Ix] [Cy] Detection State (Scaling)	0-100%
82, 87, 92, 111, 116, 121, 140, 145, 150, 169, 174, 179, 198, 203, 208, 227, 232, 237	1 Byte	0	C T R	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[Ix] [Cy] Detection State (HVAC)	Auto, Comfort, Standby, Economy, Building Protection
83, 88, 93, 112, 117, 122, 141, 146, 151, 170, 175, 180, 199, 204, 209, 228, 233, 238	1 Bit	0	C T R	DPT_Switch	0/1	[Ix] [Cy] Detection State (Binary)	Binary Value
84, 89, 94, 113, 118, 123, 142, 147, 152, 171, 176, 181, 200, 205, 210, 229, 234, 239	1 Bit	I	C W -	DPT_Switch	0/1	[Ix] [Cy] Enable Channel	According to parameters
85, 90, 95, 114, 119, 124, 142, 148, 153, 172, 177, 182, 201, 206, 211, 230, 235, 240	1 Bit	I	C W -	DPT_Switch	0/1	[Ix] [Cy] Force State	0 = No Detection; 1 = Detection
241	1 Byte	-	C W -	DPT_SceneControl	0-63; 128-191	[Outputs] Scenes	0 – 63 (Execute 1 – 64); 128 – 191 (Save 1 – 64)
242 250 259	1 Bit	Ι	C W -	DPT_BinaryValue	0/1	[Ox] On/Off	N.O. (0=Open Relay; 1=Close Relay)
242, 250, 258	1 Bit	I	C W -	DPT_BinaryValue	0/1	[Ox] On/Off	N.C. (0=Close Relay; 1= Open Relay)
243, 251, 259	1 Bit	0	C T R	DPT_BinaryValue	0/1	[Ox] On/Off (Status)	0=Output Off; 1=Output On
244, 252, 260	1 Bit	-	C W -	DPT_Enable	0/1	[Ox] Lock	0=Unlock; 1=Lock
245, 253, 261	1 Bit	Ι	C W -	DPT_Start	0/1	[Ox] Timer	0=Switch Off; 1=Switch On
246, 254, 262	1 Bit	Ι	C W -	DPT_Start	0/1	[Ox] Flashing	0=Stop; 1=Start
247, 255, 263	1 Bit	I	C W -	DPT_Alarm	0/1	[Ox] Alarm	0=Normal; 1=Alarm
247, 255, 263	1 Bit	Ι	C W -	DPT_Alarm	0/1	[Ox] Alarm	0=Alarm; 1=Normal
248, 256, 264	1 Bit	Ι	C W -	DPT_Trigger	0/1	[Ox] Unfreeze Alarm	Alarm=0 + Unfreeze=1 => End Alarm
249, 257, 265	1 Bit	0	C T R	DPT_Trigger	0/1	[Ox] Warning Time (Status)	0=Normal; 1=Warning
266	1 Byte	Ι	C W -	DPT_SceneControl	0-63; 128-191	[Shutter] Scenes	0 - 63 (Execute 1 - 64); 128 - 191 (Save 1 - 64)
267	1 Bit	I	C W -	DPT_UpDown	0/1	[CX] Move	0=Raise; 1=Lower
268	1 Bit	I	C W -	DPT_Step	0/1	[CX] Stop/Step	0=Stop/StepUp; 1=Stop/StepDown
200	1 Bit	Ι	C W -	DPT_Trigger	0/1	[CX] Stop	0=Stop; 1=Stop
269	1 Bit	I	C W -	DPT_Enable	0/1	[CX] Lock	0=Unlock; 1=Lock
270	1 Byte	I	C W -	DPT_Scaling	0% - 100%	[CX] Shutter Positioning	0%=Top; 100%=Bottom
271	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[CX] Shutter Position (Status)	0%=Top; 100%=Bottom
272	1 Byte	Ι	C W -	DPT_Scaling	0% - 100%	[CX] Slats Positioning	0%=Open; 100%=Closed
273	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[CX] Slats Position (Status)	0%=Open; 100%=Closed
274	1 Bit	0	C T R	DPT_Switch	0/1	[CX] Rising Relay (Status)	0=Open; 1=Closed

275	1 Bit	0	C T R	DPT_Switch	0/1	[CX] Lowering Relay (Status)	0=Open; 1=Closed
276	1 Bit	0	CTR	DPT Switch	0/1	[CX] Movement (Status)	0=Stopped; 1=Moving
277	1 Bit	0	C T R	 DPT_UpDown	0/1	[CX] Movement Direction (Status)	0=Upward; 1=Downward
	1 Bit	I	C W -	DPT Switch	0/1	[CX] Auto: On/Off	0=0n; 1=0ff
278	1 Bit	Ι	C W -	DPT_Switch	0/1	[CX] Auto: On/Off	0=Off; 1=On
	1 Bit	0	C T R	DPT_Switch	0/1	[CX] Auto: On/Off (Status)	0=On; 1=Off
279	1 Bit	0	C T R	DPT_Switch	0/1	[CX] Auto: On/Off (Status)	0=Off; 1=On
280	1 Bit	I	C W -	DPT_UpDown	0/1	[CX] Auto: Move	0=Raise; 1=Lower
201	1 Bit	Ι	C W -	DPT_Step	0/1	[CX] Auto: Stop/Step	0=Stop/StepUp; 1=Stop/StepDown
281	1 Bit	I	C W -	DPT_Step	0/1	[CX] Auto: Stop	0=Stop; 1=Stop
282	1 Byte	I	C W -	DPT_Scaling	0% - 100%	[CX] Auto: Shutter Positioning	0%=Top; 100%=Bottom
283	1 Byte	Ι	C W -	DPT_Scaling	0% - 100%	[CX] Auto: Slats Positioning	0%=Open; 100%=Closed
204	1 Bit	I	C T - W U	DPT_Scene_AB	0/1	[CX] Sunshine/Shadow	0=Sunshine; 1=Shadow
284	1 Bit	Ι	C T - W U	DPT_Scene_AB	0/1	[CX] Sunshine/Shadow	0=Shadow; 1=Sunshine
205	1 Bit	I	C T - W U	DPT_Heat_Cool	0/1	[CX] Cooling/Heating	0=Heating; 1=Cooling
285	1 Bit	I	C T - W U	DPT_Heat_Cool	0/1	[CX] Cooling/Heating	0=Cooling; 1=Heating
20/	1 Bit	I	C T - W U	DPT_Occupancy	0/1	[CX] Presence/No Presence	0=Presence; 1=No Presence
286	1 Bit	I	C T - W U	DPT_Occupancy	0/1	[CX] Presence/No Presence	0=No Presence; 1=Presence
287	1 Bit	Ι	C W -	DPT_Alarm	0/1	[CX] Alarm 1	0=No Alarm; 1=Alarm
287	1 Bit	I	C W -	DPT_Alarm	0/1	[CX] Alarm 1	0=Alarm; 1=No Alarm
288	1 Bit	Ι	C W -	DPT_Alarm	0/1	[CX] Alarm 2	0=No Alarm; 1=Alarm
200	1 Bit	Ι	C W -	DPT_Alarm	0/1	[CX] Alarm 2	0=Alarm; 1=No Alarm
289	1 Bit	I	C W -	DPT_Trigger	0/1	[CX] Unfreeze Alarm	Alarm1=Alarm2=No Alarm + Unfreeze (1) => End Alarm
290	1 Bit	I	C W -	DPT_Scene_AB	0/1	[CX] Move (Reversed)	0=Lower; 1=Raise
291, 292	1 Bit	Ι	C W -	DPT_Trigger	0/1	[CX] Direct Positioning X	0=No Action; 1=Go to Position
293, 294	1 Bit	Ι	C W -	DPT_Trigger	0/1	[CX] Direct Positioning X (Save)	0=No Action; 1=Save Current Position
295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326	1 Bit	I	C W -	DPT_Bool	0/1	[LF] (1 bit) Data Entry X	Binary Data Entry (0/1)
327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342	1 Byte	I	C W -	DPT_Value_1_Ucount	0 - 255	[LF] (1 byte) Data Entry X	1 byte Data Entry (0-255)
343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358	2 Bytes	I	C W -	DPST-7-1 DPST-8-1 DPST-9-1		[LF] (2 bytes) Data Entry X	2 bytes Data Entry

359, 360, 361, 362, 363, 364, 365, 366	4 Bytes	I	C W -	DPT_Value_4_Count		[LF] (4 bytes) Data Entry X	4 bytes Data Entry
	1 Bit	0	C T R	DPT_Bool	0/1	[LF] Function X - Result	(1 bit) Boolean
	1 Byte	0	C T R	DPT_Value_1_Ucount	0 - 255	[LF] Function X - Result	(1 byte) Unsigned
	2 Bytes	0	C T R	DPT_Value_2_Ucount	0 - 65535	[LF] Function X - Result	(2 bytes) Unsigned
367, 368, 369, 370, 371, 372, 373, 374, 375, 376	4 Bytes	0	C T R	DPT_Value_4_Count		[LF] Function X - Result	(4 bytes) Signed
373, 374, 373, 370	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[LF] Function X - Result	(1 byte) Percentage
	2 Bytes	0	C T R	DPT_Value_2_Count	-32768 - 32767	[LF] Function X - Result	(2 bytes) Signed
	2 Bytes	0	C T R	DPT_Value_Temp	-273.00 - 670760.00	[LF] Function X - Result	(2 bytes) Float
377	1 Byte	I	c w u	DPT_SceneControl	0-63; 128-191	[Fan Coil] Scenes	0 - 63 (Execute 1 - 64); 128 - 191 (Save 1 - 64)
378	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] On/Off	0 = Off; 1 = On
379	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] On/Off (Status)	0 = Off; 1 = On
380	1 Bit	I	C W U	DPT_Heat_Cool	0/1	[FCX] Mode	0 = Cool; 1 = Heat
381	1 Bit	0	C T R	DPT_Heat_Cool	0/1	[FCX] Mode (Status)	0 = Cool; 1 = Heat
202	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic	0 = Automatic; 1 = Manual
382	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic	0 = Manual; 1 = Automatic
383	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic (Status)	0 = Automatic; 1 = Manual
	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic (Status)	0 = Manual; 1 = Automatic
384	1 Bit	Ι	C W U	DPT_Step	0/1	[FCX] Manual Fan: Step Control	0 = Down; 1 = Up

382	1 Bit	Ι	C W U	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic	0 = Automatic; 1 = Manual
382	1 Bit	Ι	C W U	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic	0 = Manual; 1 = Automatic
383	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic (Status)	0 = Automatic; 1 = Manual
383	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Fan: Manual/Automatic (Status)	0 = Manual; 1 = Automatic
384	1 Bit	Ι	C W U	DPT_Step	0/1	[FCX] Manual Fan: Step Control	0 = Down; 1 = Up
385, 386, 387, 388	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] Manual Fan: Speed X	0 = Off; 1 = On
389, 390, 391, 392	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Fan: Speed X (Status)	0 = Off; 1 = On
	1 Byte	Ι	C W U	DPT_Value_1_Ucount	0 - 255	[FCX] Manual Fan: Enumeration Control	S0 = 0; S1 = 1; S2 = 2; S3 = 3
393	1 Byte	Т	C W U	DPT_Value_1_Ucount	0 - 255	[FCX] Manual Fan: Enumeration Control	0 = S0; 1 = S1; 2 = S2
	1 Byte	I	C W U	DPT_Value_1_Ucount	0 - 255	[FCX] Manual Fan: Enumeration Control	0 = S0; 1 = S1
	1 Byte	0	C T R	DPT_Value_1_Ucount	0 - 255	[FCX] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1; S2 = 2; S3 = 3
394	1 Byte	о	C T R	DPT_Value_1_Ucount	0 - 255	[FCX] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1; S2 = 2
	1 Byte	0	C T R	DPT_Value_1_Ucount	0 - 255	[FCX] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1
395	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Manual Fan: Percentage Control	S0 = 0%; S1 = 0,4-33,3%; S2 = 33,7-66,7%; S3 = 67,1-100%

						[FCX] Manual Fan: Percentage	0% = S0; 1-50% = S1; 51-100% =
	1 Byte	I	C W U	DPT_Scaling	0% - 100%	Control	0% = 50; 1-50% = 51; 51-100% = S2
	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Manual Fan: Percentage Control	0% = S0; 1-100% = S1
	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[FCX] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 33,3%; S2 = 66,6%; S3 = 100%
396	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[FCX] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 50,2%; S2 = 100%
	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[FCX] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 100%
397	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Cooling Fan: Continuous Control	0 - 100%
377	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Cooling Valve: PI Control (Continuous)	0 - 100%
398	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Heating Fan: Continuous Control	0 - 100%
370	1 Byte	I	C W U	DPT_Scaling	0% - 100%	[FCX] Heating Valve: PI Control (Continuous)	0 - 100%
399	1 Bit	I	C W U	DPT_OpenClose	0/1	[FCX] Cooling Valve: Control Variable (X bit)	0 = Open Valve; 1 = Close Valve
244	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] Cooling Valve: Control Variable (X bit)	0 = Close Valve; 1 = Open Valve
400	1 Bit	I	C W U	DPT_OpenClose	0/1	[FCX] Heating Valve: Control Variable (X bit)	0 = Open Valve; 1 = Close Valve
400	1 Bit	I	C W U	DPT_Switch	0/1	[FCX] Heating Valve: Control Variable (X bit)	0 = Close Valve; 1 = Open Valve
	1 Bit	0	C T R	DPT_OpenClose	0/1	[FCX] Cooling Valve (Status)	0 = Open; 1 = Closed
401	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Cooling Valve (Status)	0 = Closed; 1 = Open
401	1 Bit	0	C T R	DPT_OpenClose	0/1	[FCX] Valve (Status)	0 = Open; 1 = Closed
	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Valve (Status)	0 = Closed; 1 = Open
100	1 Bit	0	C T R	DPT_OpenClose	0/1	[FCX] Heating Valve (Status)	0 = Open; 1 = Closed
402	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Heating Valve (Status)	0 = Closed; 1 = Open
403	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Cooling Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
404	1 Bit	0	C T R	DPT_Switch	0/1	[FCX] Heating Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
405	1 Byte	0	C T R	DPT_Scaling	0% - 100%	[FCX] Valve (Status)	0 - 100%
406	1 Bit	0	C T R	DPT_Bool	0/1	[FCX] Control Value - Error	0 = No Error; 1 = Error

407	2 Bytes	I	C W U	DPT_Value_Temp	-273.00 - 670760.00	[FCX] Ambient Temperature	Ambient Temperature
408	2 Bytes	Ι	C W U	DPT_Value_Temp	-273.00 - 670760.00	[FCX] Setpoint Temperature	Setpoint Temperature
100	2 Bytes	1/0	CTRWU	DPT_TimePeriodMin		[FCX] Duration of Manual Control	0 = Endless; 1 - 1440 min
409	2 Bytes	1/0	CTRWU	DPT_TimePeriodHrs		[FCX] Duration of Manual Control	0 = Endless; 1 - 24 h
410	1 Bit	I	C W -	DPT_Switch	0/1	[ML] Trigger	Trigger the Master Light Function
411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422	1 Bit	I	C W -	DPT_Switch	0/1	[ML] Status Object X	Binary Status
423	1 Bit	0	C T R	DPT_Switch	0/1	[ML] General Status	Binary Status
424	1 Bit		СТ	DPT_Switch	0/1	[ML] General Switch Off: Binary Object	Switch Off Sending
425	1 Byte		СТ	DPT_Scaling	0% - 100%	[ML] General Switch Off: Scaling	0-100%
426	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[ML] General Switch Off: Scene	Scene Sending
427	1 Byte		СТ	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[ML] General Switch Off: HVAC mode	Auto, Comfort, Standby, Economy, Building Protection
428	1 Bit		СТ	DPT_Switch	0/1	[ML] Courtesy Switch On: Binary Object	Switch On Sending
429	1 Byte		СТ	DPT_Scaling	0% - 100%	[ML] Courtesy Switch On: Scaling	0-100%
430	1 Byte		СТ	DPT_SceneControl	0-63; 128-191	[ML] Courtesy Switch On: Scene	Scene Sending
431	1 Byte		СТ	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[ML] Courtesy Switch On: HVAC mode	Auto, Comfort, Standby, Economy, Building Protection
432	1 Bit		СТ	DPT_Trigger	0/1	[Heartbeat] Object to Send '1'	Sending of '1' Periodically



Join and send us your inquiries about Zennio devices: http://support.zennio.com

Zennio Avance y Tecnología S.L.

C/ Río Jarama, 132. Nave P-8.11 45007 Toledo (Spain).

Tel. +34 925 232 002.

www.zennio.com info@zennio.com

